


# Air Conditioner Remote Alerts

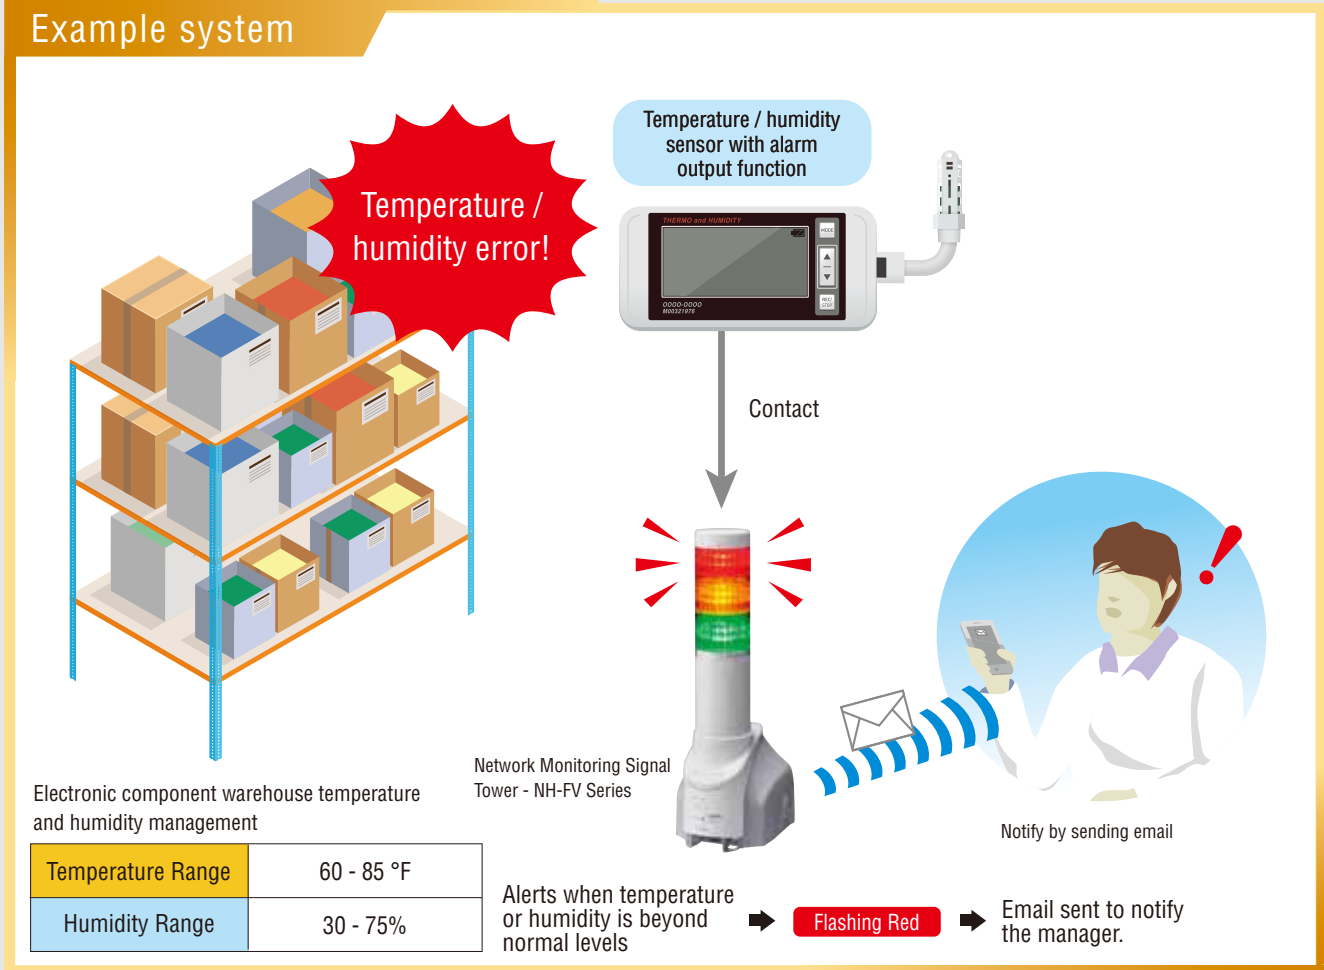

## Before

To maintain the quality of parts, temperature and humidity control is essential. However, periodic work site checks are time-consuming.

## After

The NH-FV Network Monitoring Signal Tower alerts site managers via visual, audible and email alerts when there are irregularities in temperature or humidity.

## Industry Overview

- Industry** • Semiconductor and electronic components

## Device configuration

NH-FV Series x 1 unit

Network Monitoring Signal Tower  
NH-FV Series

